




First order Raman spectrum of a type Ia diamond anvil without Raman selection

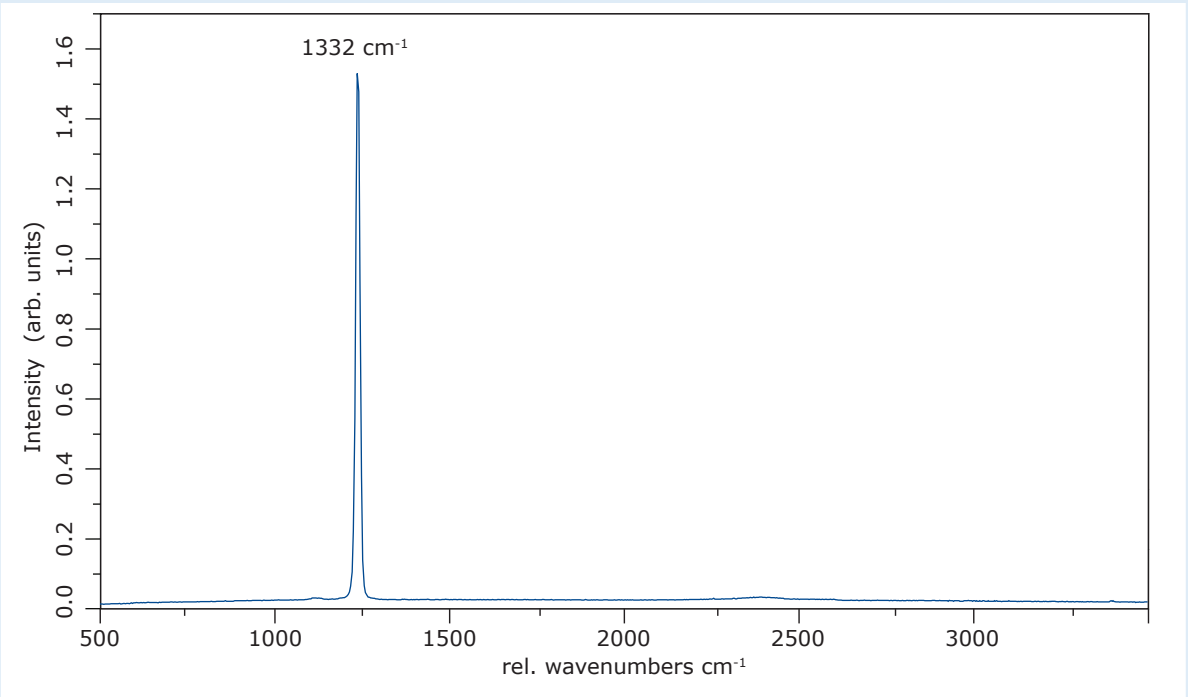


Second order Raman spectrum of a type Ia diamond anvil without Raman selection

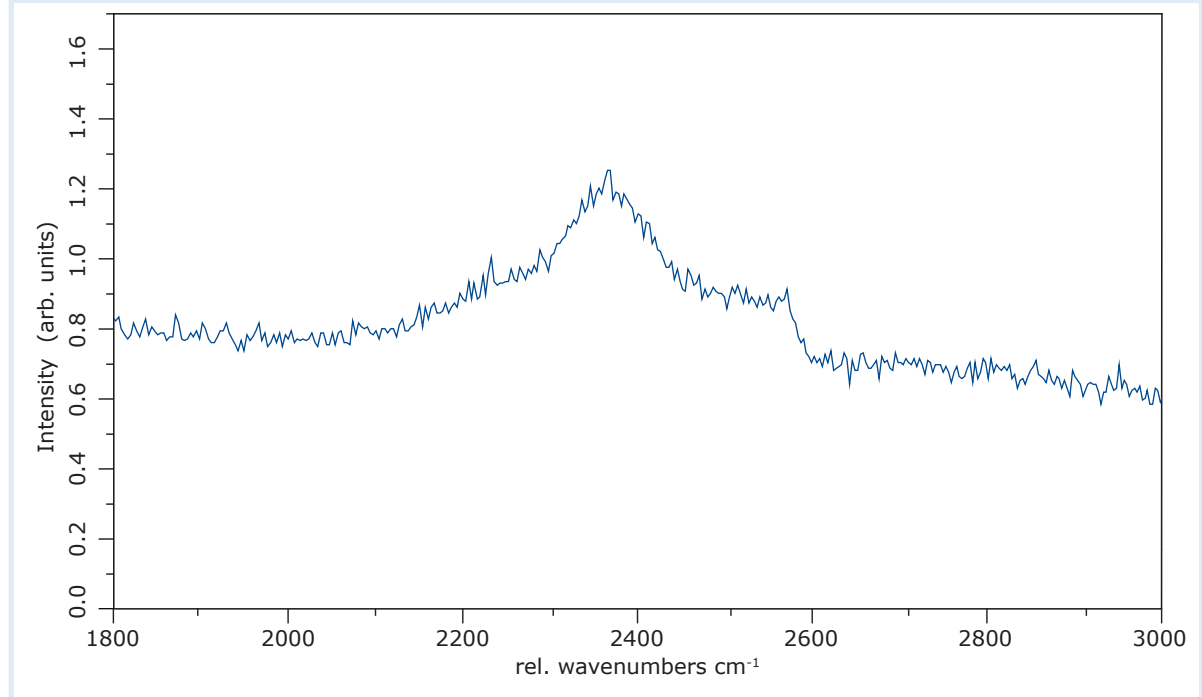


First order Raman spectrum of a type Ia diamond anvil with Raman low fluorescence selection

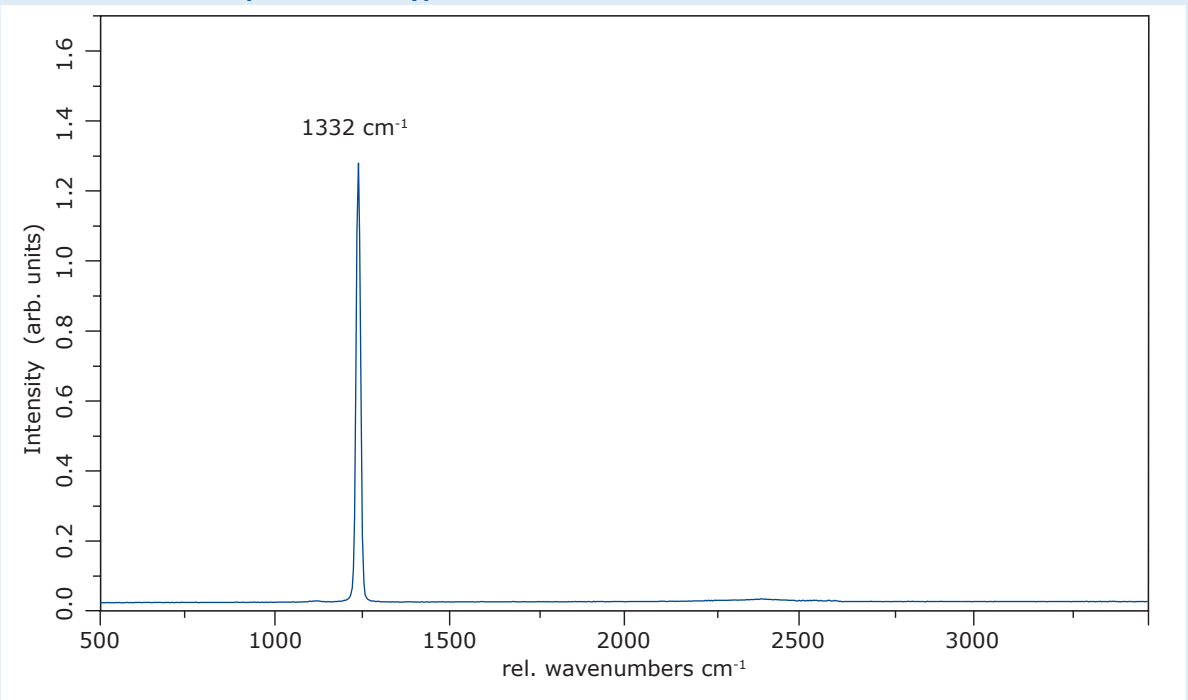

Second order Raman spectrum of a type Ia diamond anvil with Raman low fluorescence selection

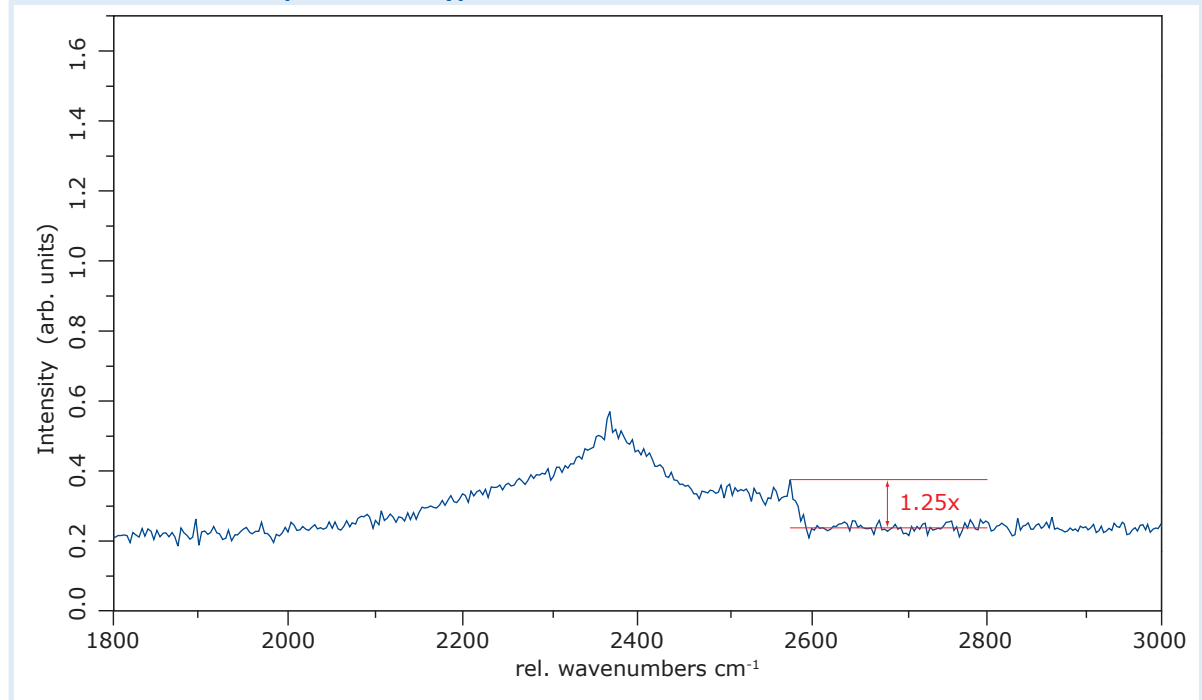

First order Raman spectrum of a type Ia diamond anvil with Raman ultra low fluorescence selection

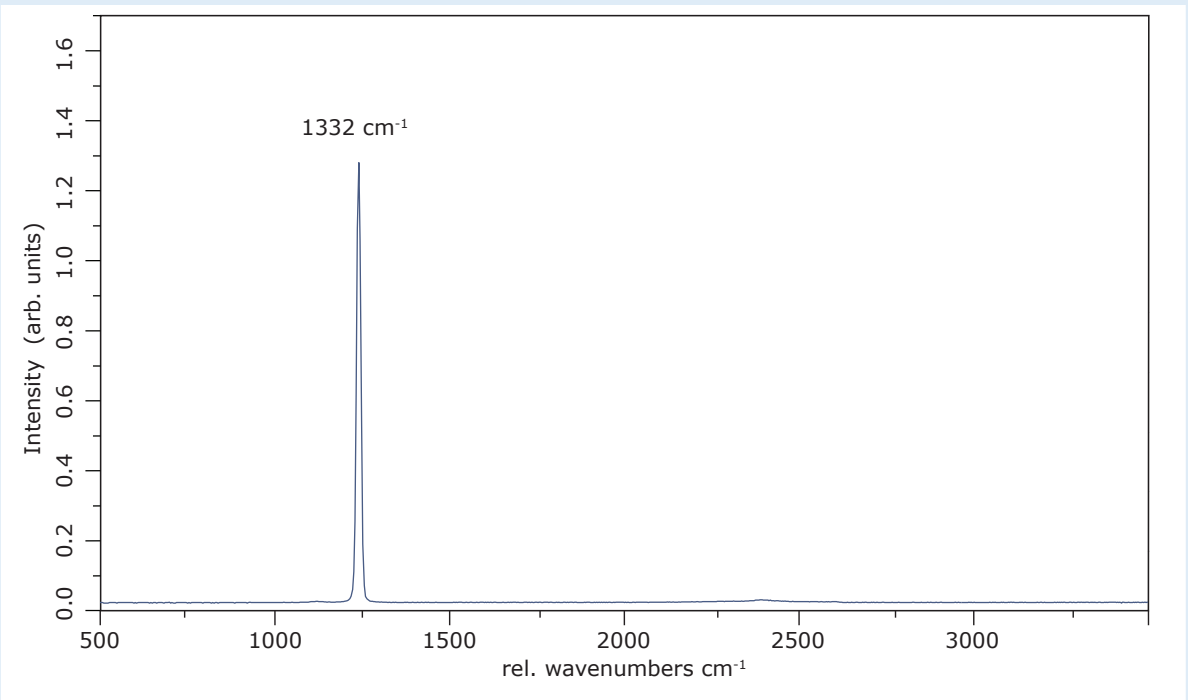

Second order Raman spectrum of a type Ia diamond anvil with Raman ultra low fluorescence selection

